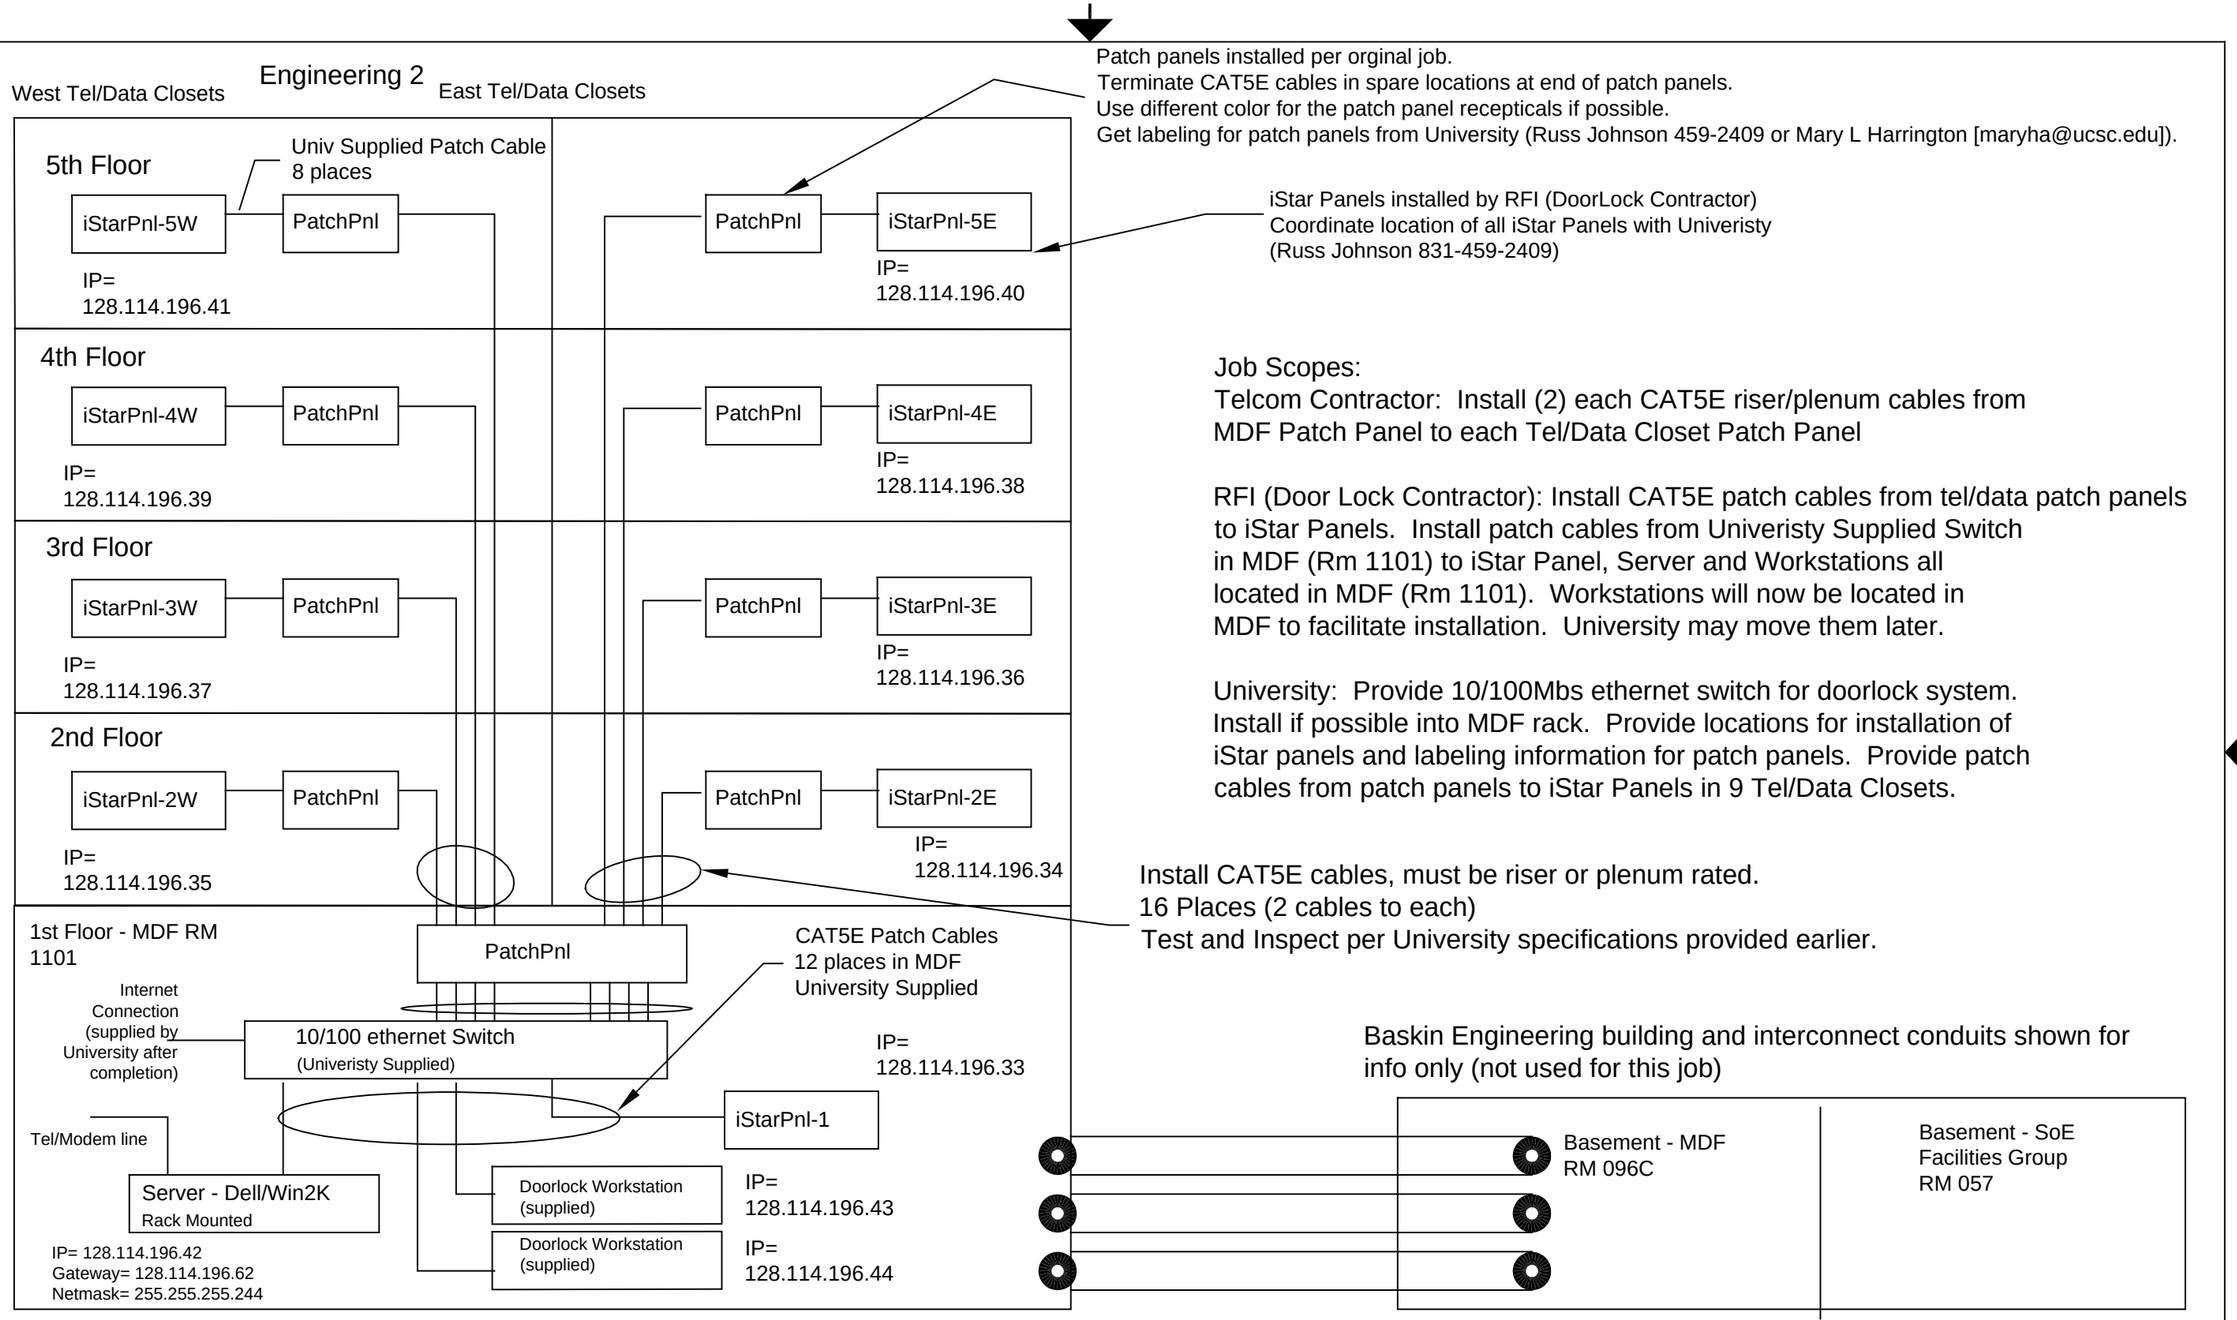

Job Scopes:
Telcom Contractor: Install (2) each CAT5E riser/plenum cables from MDF Patch Panel to each Tel/Data Closet Patch Panel

RFI (Door Lock Contractor): Install CAT5E patch cables from tel/data patch panels to iStar Panels. Install patch cables from Univeristy Supplied Switch in MDF (Rm 1101) to iStar Panel, Server and Workstations all located in MDF (Rm 1101). Workstations will now be located in MDF to facilitate installation. University may move them later.

University: Provide 10/100Mbs ethernet switch for doorlock system. Install if possible into MDF rack. Provide locations for installation of iStar panels and labeling information for patch panels. Provide patch cables from patch panels to iStar Panels in 9 Tel/Data Closets.

E2 Door Lock System Networking

SIZE	FSCM NO.	DWG NO.	REV
SCALE		SHEET	

FNAME REVDATE USER